
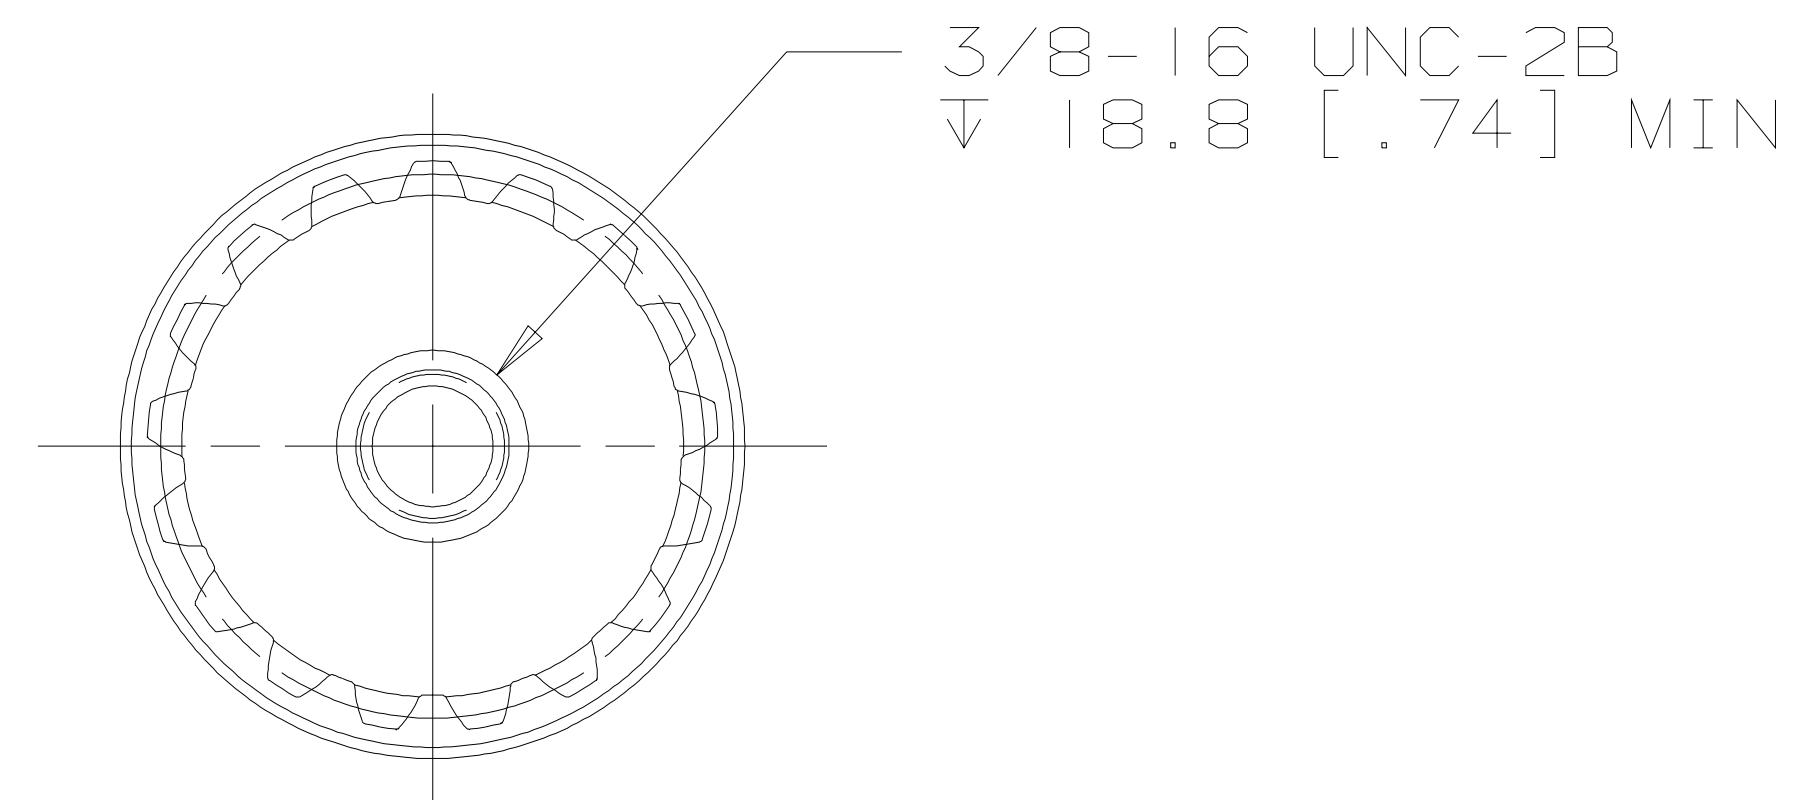


SYM	REVISION	BY	DATE	ECN
A	ENGINEERING RELEASE	SDR	2-8-92	21551
B	ADDED THREAD CALLOUT TO SHAFT END	RAF	4-16-96	28005
C	62.7/60.7 [2.47/2.39] WAS 62.5/61.5 [2.48/2.40]	AGJ	5-17-04	47918
C	-1) MOUNTING TYPE WAS "F" -2) OUTPUT SHAFT WAS "13"	SSD	1-24-07	0002527

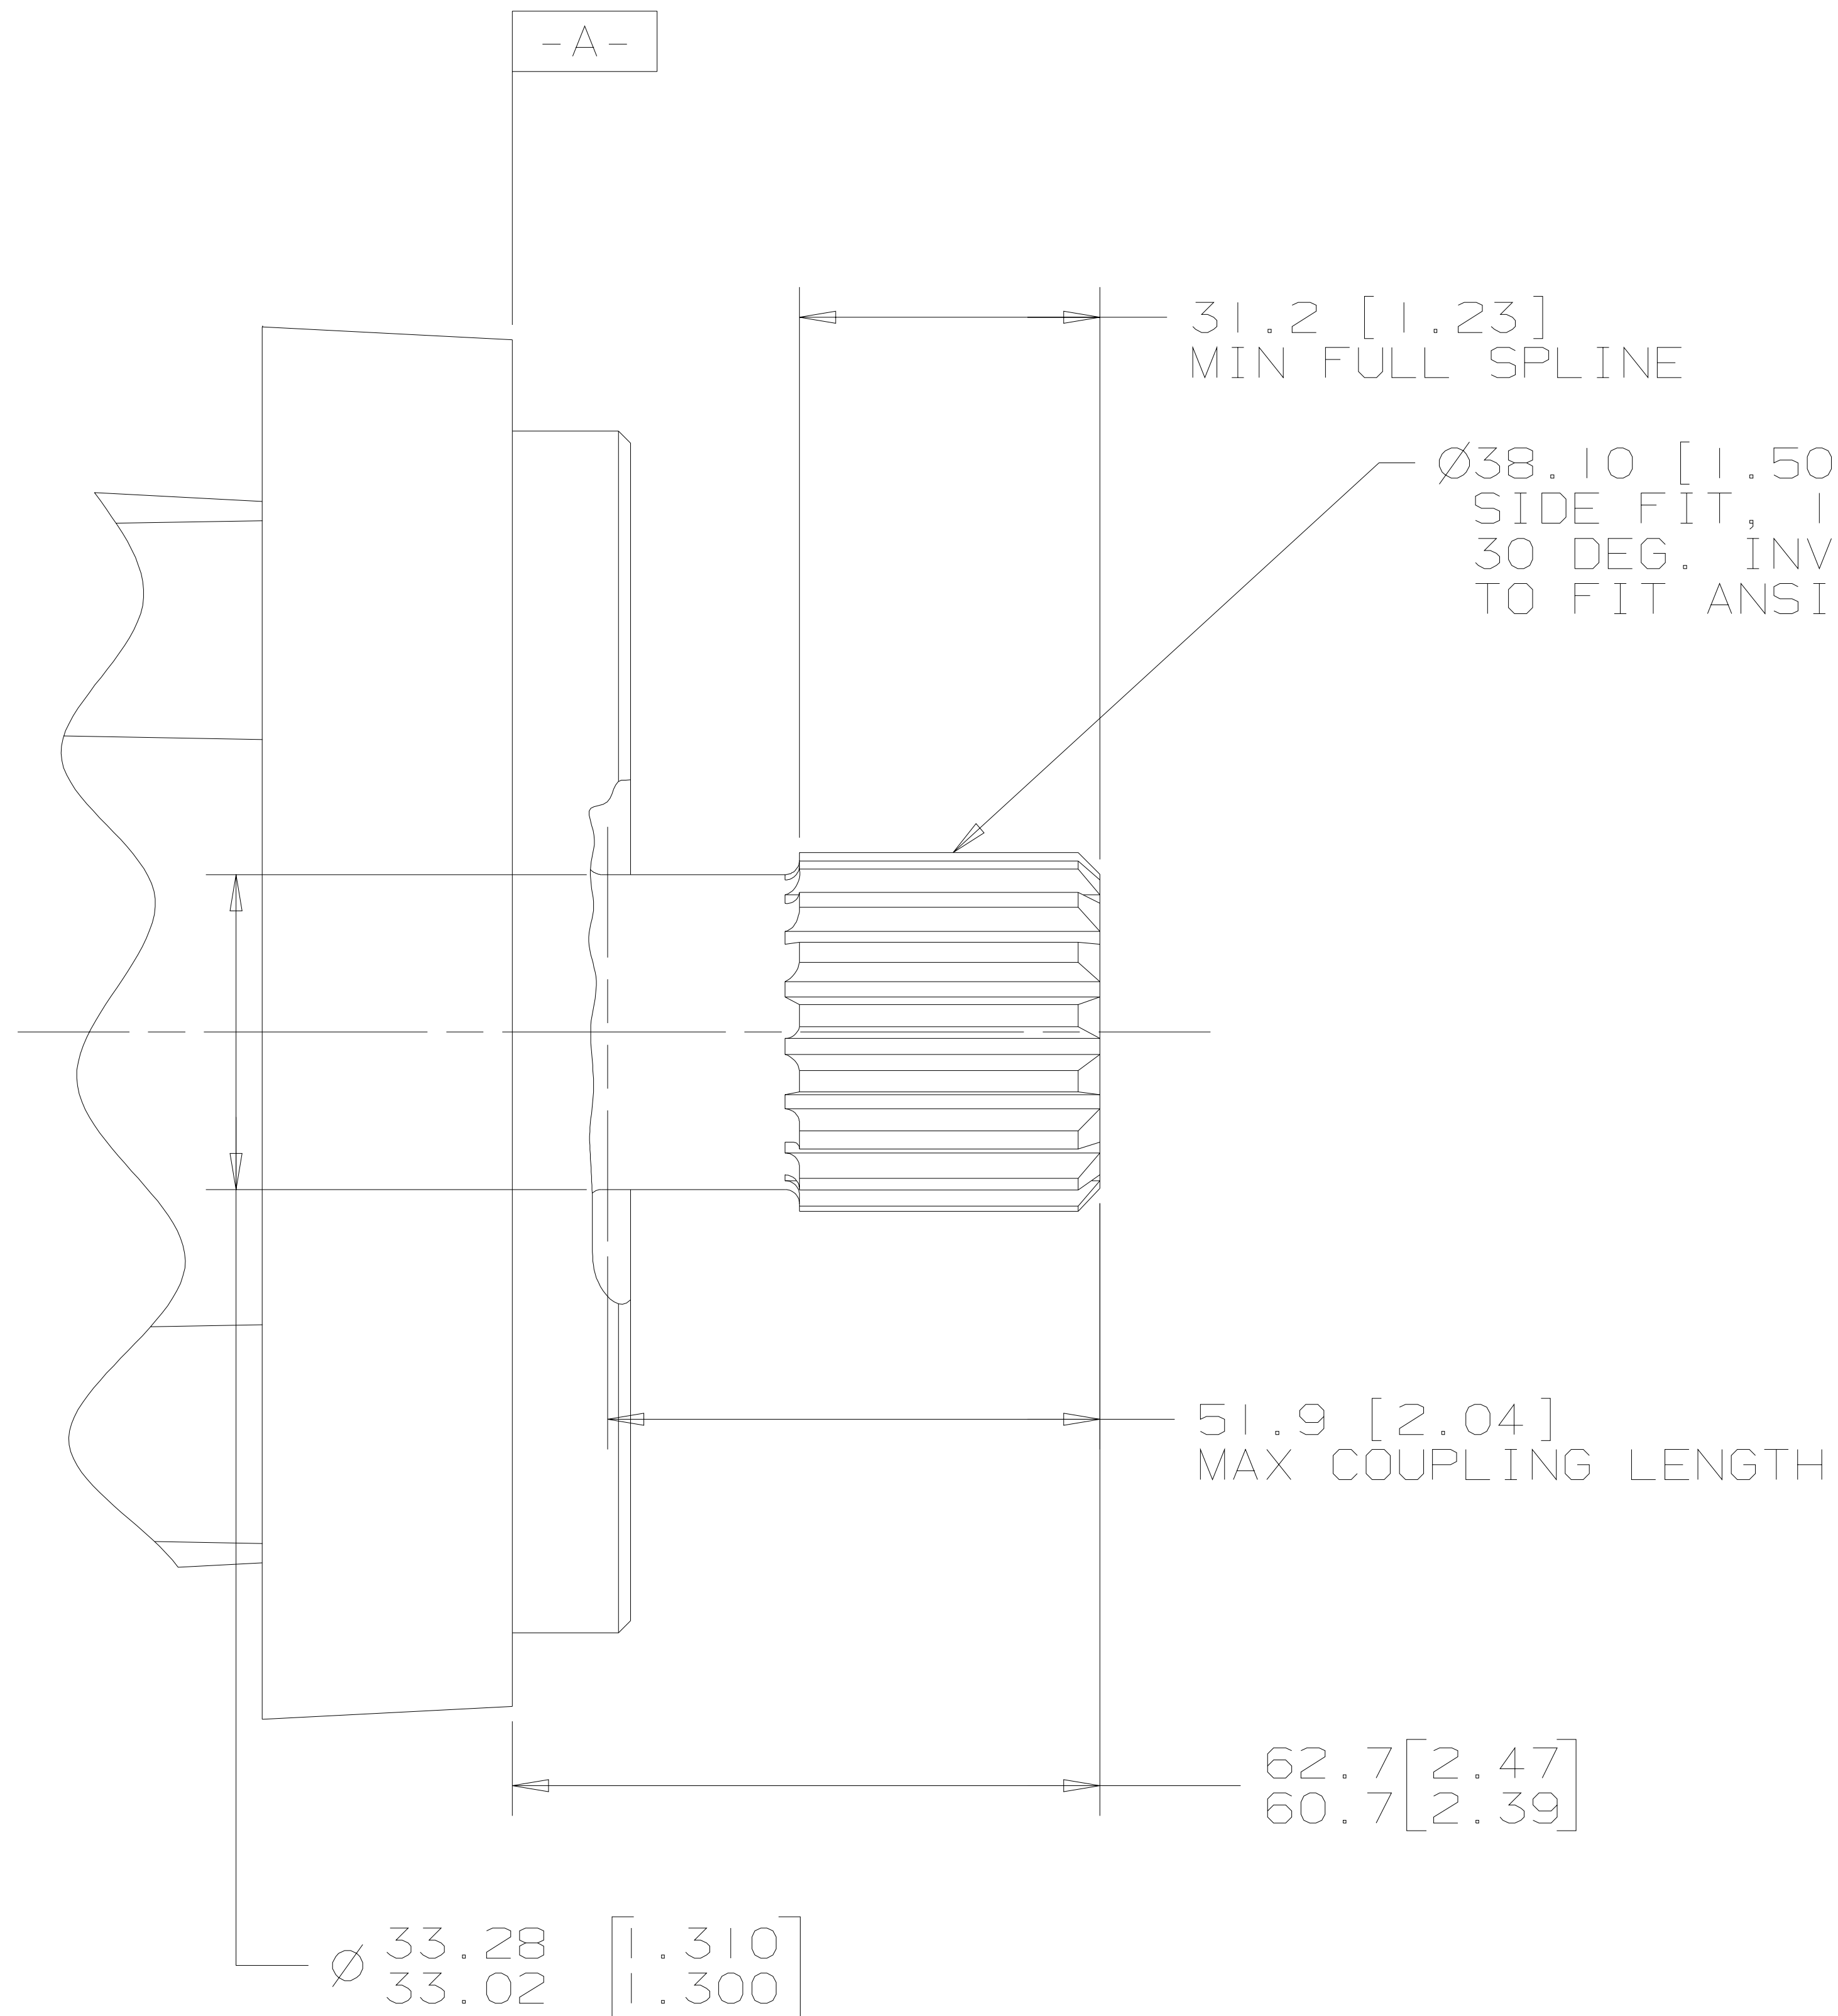

NOTE

- 1 MOUNTING TYPE: OPTION AF
- 2 OUTPUT SHAFT: OPTION 10

UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN INCHES <input type="checkbox"/> MILLIMETERS [INCHES] <input checked="" type="checkbox"/>		DRAWING BASED ON ANSI Y14.5M-1982	
TOLERANCES .X ± ---- .XX ± REF .XXX ± ONLY < ----		NOTICE TO PERSONS RECEIVING THIS DRAWING AND / OR TECHNICAL INFORMATION Eaton Corporation claims proprietary rights in the information disclosed hereon. This document is issued in confidence and is not to be reproduced or used to manufacture anything shown hereon without the written permission of the Eaton Corporation.	
UNSPECIFIED RADII ARE		DRAWN BY/DATE SDR 4/9/92 MATERIAL/HEAT TREAT	
UNSPECIFIED DRAFT ANGLES ARE		CHECKED BY/DATE KJR 7-8-92	
DRAWING FORMAT CADD <input checked="" type="checkbox"/> MANUAL <input type="checkbox"/>		ENGRG BY/DATE RVA 7-31-92 TITLE 4000 SERIES MOTOR SHAFT INSTALLATION	
THIRD ANGLE PROJECTION DO NOT SCALE		METALLURGY BY/DATE	
MICROINCHES <input checked="" type="checkbox"/> MICROMETERS [MICROINCHES] <input type="checkbox"/>		NUMBER A-609-009	
ARITHMETICAL AVERAGE <input checked="" type="checkbox"/>		SCALE 1/1 SHEET 1 OF 1	

